




# 3 PHASE VACUUM CONTACTORS - 1500 Volts Maximum



| Item | Description   | Part Number  |
|------|---|--------------|
| 1    | Safety Shield (Blank) 1500V Rated                                 | 40758-804-01 |
| 2    | Vacuum Bottle Kit<br>(each kit contains three bottles & contacts) |              |
|      | 180...200 A Contactors  | 40758-801-01 |
|      | 350 A Contactors  | 40758-801-02 |
|      | 450 A Contactors  | 40758-801-03 |
|      | 610 A Contactors  | 40758-805-01 |
| 3    | Coil for 180...450 A Contactors                                   |              |
|      | 100...127V AC 50/60 Hz  | 40758-800-01 |
|      | 200...240V AC 50/60 Hz  | 40758-800-02 |
|      | 380...440V AC 50/60 Hz  | 40758-800-03 |
|      | 460...550V AC 50/60 Hz  | 40758-800-04 |
|      | 100...110V DC   | 40758-800-05 |
|      | 200...220V DC   | 40758-800-06 |
|      | Coil for 610 A Contactors   |              |
|      | 100...127V AC 50/60 Hz  | 40758-806-01 |
|      | 200...240V AC 50/60 Hz  | 40758-806-02 |
| 4    | Auxiliary Contact Block (1 N.O. - 1 N.C.)                         | 40758-802-01 |
|      | Additional Auxiliary Contact Block<br>(can be added in the field) |              |
|      | 180...450 A Contactors  | 1195-N1      |
|      | 610 A Contactors  | 1195-N2      |

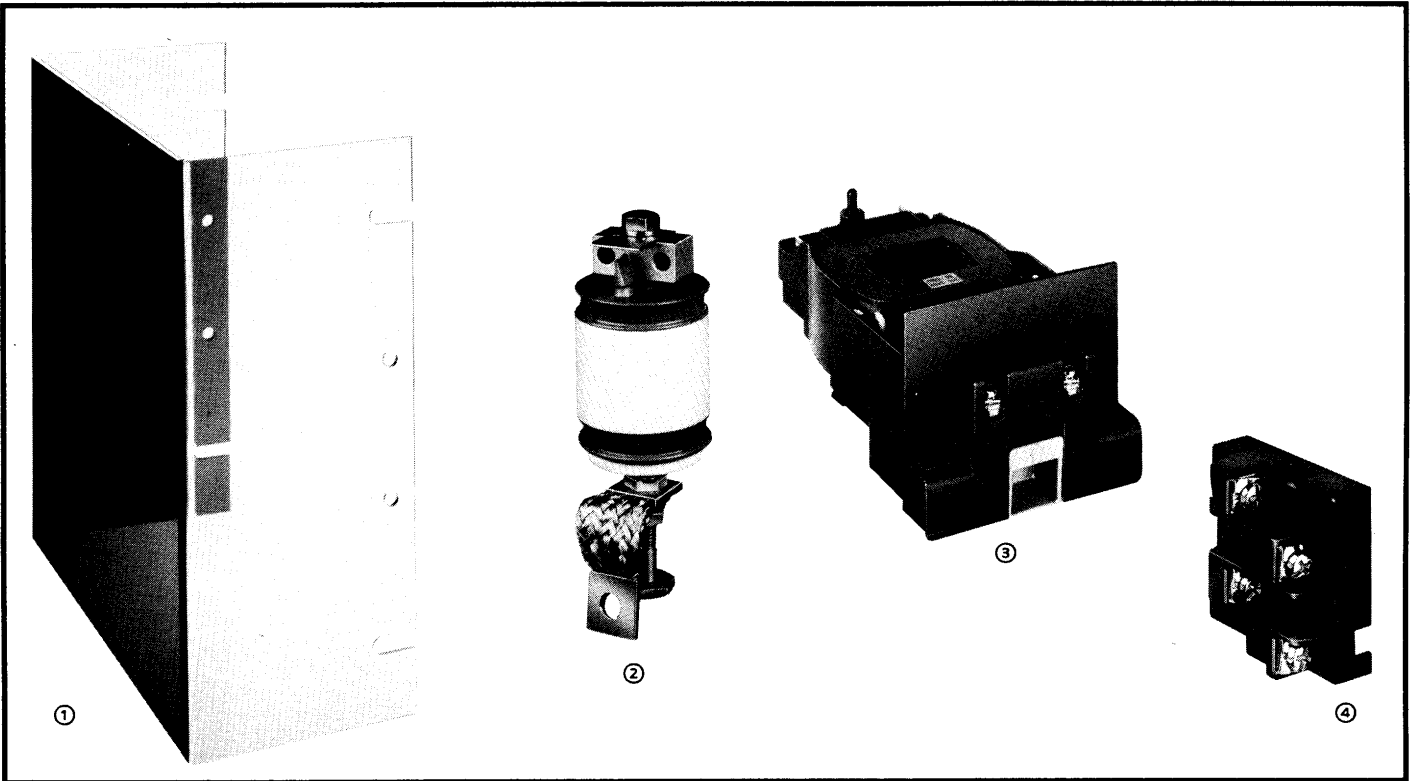

**WARNING:** To avoid hazards of electrical shock, remove all power before proceeding. Auxiliary contacts commonly control separate sources of power. Be sure they and all sources of power are disconnected.

**OPERATING ENVIRONMENT** - Contactors should always be maintained in a clean and dry condition for dependable operation. Choice of the proper NEMA enclosure type for the application is very important.

**PREVENTIVE MAINTENANCE** - For recommended preventive maintenance instructions refer to Publication GI-5.0 or the Industrial Control Catalog.

**ORDERING INFORMATION** - Your order cannot be entered unless the part number and description of part is given. This renewal parts list also applies to these contactors when used on control apparatus under other Bulletin Numbers.

**ALLEN-BRADLEY**  
A ROCKWELL INTERNATIONAL COMPANY

Industrial Control Group  
Milwaukee, Wisconsin 53204

Publication 1100-6.0.1 November 2002  
Supersedes Publication 1100-6.0 September 1987