


Connecting PLC-5 Processors and SLC Processors over a Serial Link

Using SLC 5/03™ Processors

Introduction

This document combines available PLC® and SLC™ documentation to show you how you can communicate between these two types of systems over a serial link.

Note: Channel 0 on the SLC 5/04™ processor also supports the connections described in this guide.

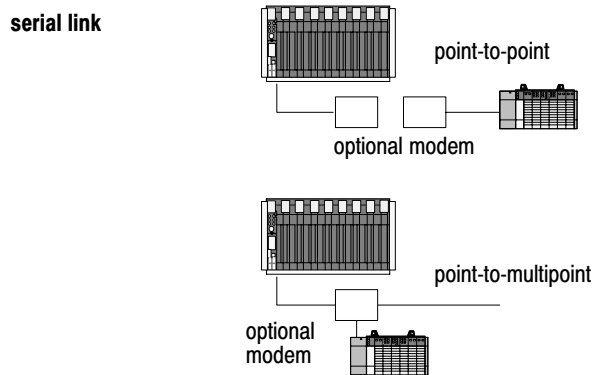


This information is in addition to the user documentation for the processors and communication modules discussed here. You should already have a solid understanding of how to use these processors. Each section in this document lists additional documentation you can refer to for detailed information.

This document is part of a larger set of reference materials to help you better use your PLC-5® processor. The 1785-6.8.x series of documents provides individual documents for different applications. This reference set is continually expanding, so see your Allen-Bradley sales representative or distributor for an up-to-date list of available reference documents.


For information about:	See page:
Connecting the processors	
Point-to-point connection (full duplex)	3
Application requirements	5
Communicating over a serial link	5
Connecting the processors	
Point-to-multipoint connection (half duplex)	6
Application requirements	8
Communicating over a serial link	9
Programming MSG instructions	
Using peer-to-peer commands	14
Using a PLC-2 compatibility file	21

Connecting the processors

Point-to-point connection (full duplex)

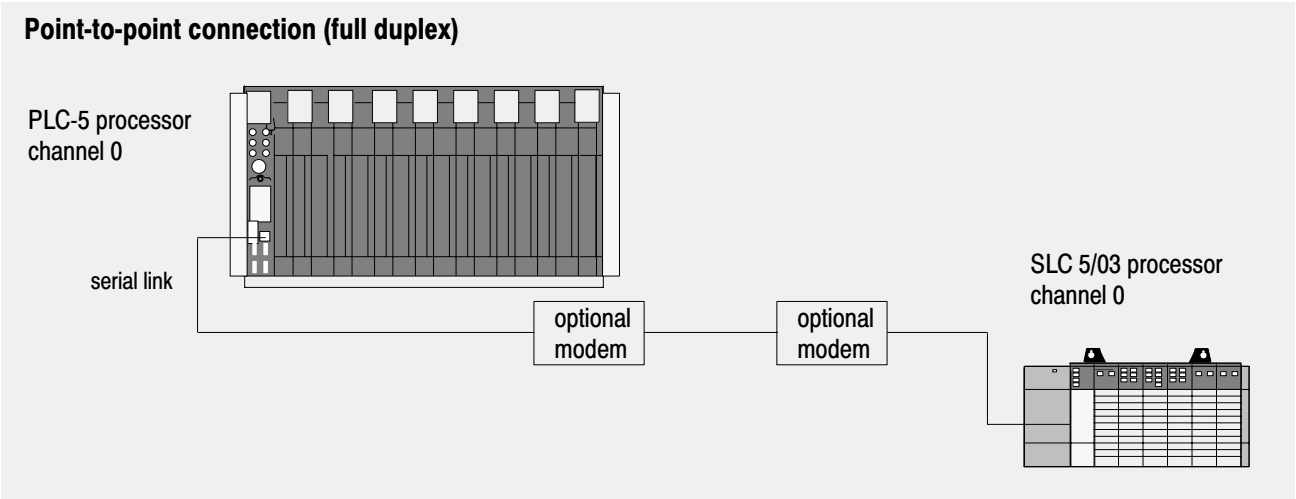


PLC-5 processor



25-pin male	25-pin female
1	C.GND 1
2	TXD.OUT 2
3	RXD.IN 3
4	RTS.OUT 4
5	CTS.IN 5
6	DSR.IN 6
7	SIG.GND 7
8	DCD.IN 8
20	DTR.OUT 20

25-pin male connector

SLC 5/03 processor

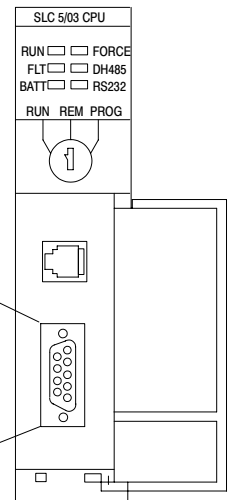


25-pin male	9-pin female
8	DCD.IN 1
3	RXD.IN 2
2	TXD.OUT 3
20	DTR.OUT 4
7	SIG.GND 5
6	DSR.IN 6
4	RTS.OUT 7
5	CTS.IN 8
22	NC 9

9-pin female connector

Configuring the processors for point-to-point (full duplex)

use your PLC-5 programming software
to configure PLC-5 channel 0



```

Channel Overview

Channel 0:  SYSTEM (POINT-TO-POINT)

System Mode (Point-to-Point)
Channel 0 Configuration

Diag. file:          19
Remote mode change:  DISABLED          System mode char.:  S
Mode attention char.: \0x1b          User mode char.:    U


Baud rate:          1200          Parity:              NONE
Stop bits:          1
Control line: FULL DUPLEX MODEM

Duplicate detect:   ON          Error detect:        CRC
ACK timeout (20 ms): 100        NAK receive:         3
Msg appl timeout (30sec): 0      DF1 ENQS:            3

Press a function key or enter a value.
>
Rem Prog  Forces:None          5/40 File BATCHTES
Accept    Chan 0 Select
Edits     Status  Option
F1        F9     F10

```

use your SLC programming software
to configure SLC 5/03 channel 0



```

+----- Channel Configuration -----+
CHANNEL 0 CONFIGURATION
Current Communication Mode: SYSTEM
User Mode Driver: DF1 FULL-DUPLEX
Write Protect: DISABLED
Mode Change: RESERVED
Mode Attention Character: RESERVED
System Mode Character: RESERVED
User Mode Character: RESERVED
Edit Resource/File Owner Timeout: 60 (seconds)

CHANNEL 1 CONFIGURATION
System Mode Driver: DH-485 MASTER
Write Protect: DISABLED
Edit Resource/File Owner Timeout: 10 (seconds)

+----- CHANNEL 0 SYSTEM MODE CONFIGURATION -----+
Communication Driver: DF1 FULL-DUPLEX
Diagnostic File: RESERVED
Baud Rate: 1200          Parity: NONE
Duplicate Detect: DISABLED          Error Detect: CRC
ACK Timeout [x20 ms]: 50          NAK Retries: 3
ENQ Retries: 3
Control Line: FULL-DUPLEX MODEM Embedded REsponse: ENABLED

Press a function key
REM PROG

ACCEPT    UNDO          CHANNEL    SELECT
EDITS     EDITS        STATUS     OPTION
F1        F2           F9        F10

```


Application requirements

Full-duplex DF1 protocol is best for applications where you need high performance peer-to-peer communication.

The maximum cable length for an RS-232 serial link is 15 m (50 ft).

Communicating over a serial link

In a point-to-point configuration, the messaging is between the two connected devices.

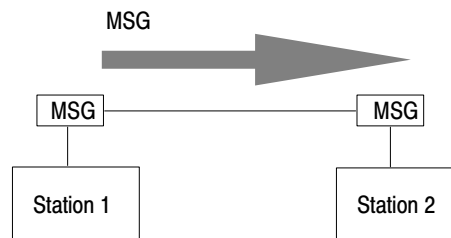

Using full-duplex protocol

Full-duplex DF1 protocol (also referred to as DF1 point-to-point protocol) lets you use RS-232 point-to-point communication. This type of protocol supports simultaneous transmissions between two devices in both directions. You can use channel 0 as a programming port or as a peer-to-peer port using the MSG instruction.


By setting a parameter in Advanced Programming Software (APS), you can also make the processor verify that the host computer can receive embedded responses. To do this, the processor waits to receive an embedded response from the host computer before sending one of its own. A host computer that can send embedded responses should also be able to receive them.

If you use modems with full-duplex DF1 protocol, make sure that they are capable of simultaneous bidirectional communication. Typically, dial-up modems designed to be connected to standard telephone lines can support full-duplex.


Additional documentation

- 1747-6.2 SLC 500 Modular Hardware Style Installation and Operation Manual
- 1785-6.1 PLC-5 Programming Software Instruction Set Reference Manual
- 1770-6.5.16 Data Highway/Data Highway Plus/DH-485 Protocol and Command Set Reference Manual
- AG-6.5.8 SCADA System Application Guide

Connecting the processors

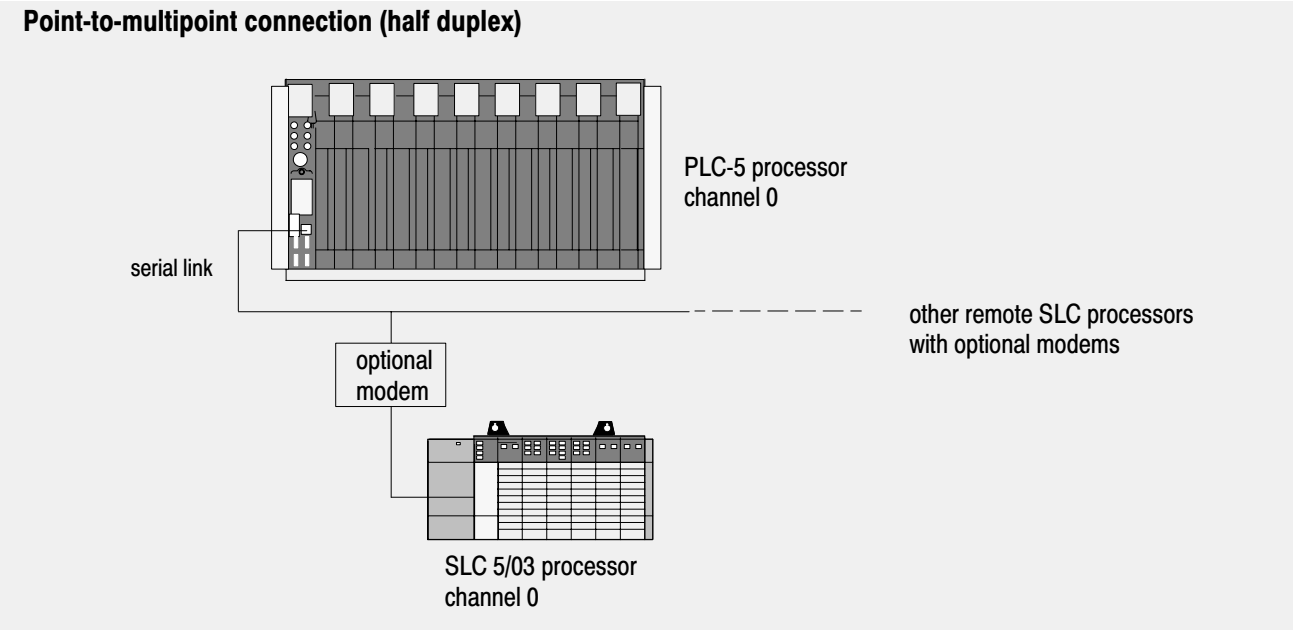

PLC-5 processor

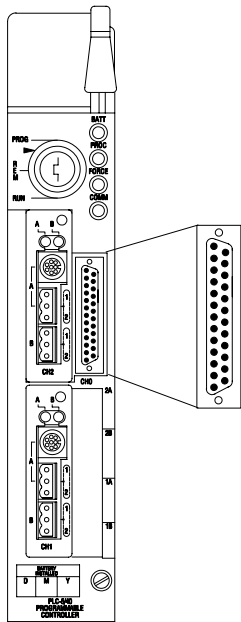

25-pin male connector

25-pin male	25-pin female
1	C.GND 1
2	TXD.OUT 2
3	RXD.IN 3
4	RTS.OUT 4
5	CTS.IN 5
6	DSR.IN 6
7	SIG.GND 7
8	DCD.IN 8
20	DTR.OUT 20


25-pin male

9-pin female

8	DCD.IN 1
3	RXD.IN 2
2	TXD.OUT 3
20	DTR.OUT 4
7	SIG.GND 5
6	DSR.IN 6
4	RTS.OUT 7
5	CTS.IN 8
22	NC 9


9-pin female connector

SLC 5/03 processor

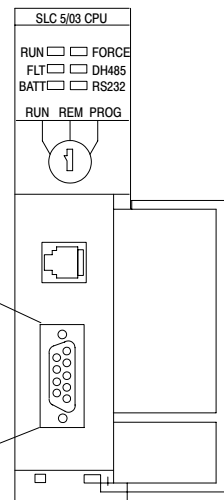

**Configuring the processors for point-to-multipoint (half duplex)
Using PLC-5 standard-based communication mode**

use your PLC-5 programming software to configure PLC-5 channel 0



Create station lists.

```

Channel Overview

Channel 0:  SYSTEM (MASTER)

System Mode (Master)
Channel 0 Configuration

Diag. file:          19
Remote mode change: DISABLED      System mode char.:  S
Mode attention char.: \0x1b      User mode char.:   U

Baud rate:          9600          Parity:             NONE
Stop bits:          1             Station address:    1
Control line:       HALF DUPLEX WITHOUT CONTINUOUS CARRIER

Reply msg wait (20 ms):  25          Error detect:       CRC

ACK Timeout (20 ms):   50          RTS send delay (20 ms):  0
DF1 retries:          3             RTS off delay (20 ms):  0
Msg appl timeout (30sec):  1

Polling Mode: STANDARD (MULTIPLE MESSAGE TRANSFER PER NODE FILE SCAN)


Master message transmit: BETWEEN STATION POLLS

Normal Poll File:     0             Priority Poll File:    0
Active Station File:  0             Normal Poll Group Size: 0

Press a function key or enter a value.
>
Rem Prog  Forces:None                5/30 File BATCH30
Accept    Chan 0 Select
Edits     Status Option
F1        F9      F10
    
```

Using PLC-5 message-based communication mode

use your PLC-5 programming software to configure PLC-5 channel 0



continued on next page

```

Channel Overview

Channel 0:  SYSTEM (MASTER)

System Mode (Master)
Channel 0 Configuration

Diag. file:          19
Remote mode change: DISABLED      System mode char.:  S
Mode attention char.: \0x1b      User mode char.:   U

Baud rate:          9600          Parity:             NONE
Stop bits:          1             Station address:    1
Control line:       HALF DUPLEX WITHOUT CONTINUOUS CARRIER

Reply msg wait (20 ms):  25          Error detect:       CRC

ACK Timeout (20 ms):   50          RTS send delay (20 ms):  0
DF1 retries:          3             RTS off delay (20 ms):  0
Msg appl timeout (30sec):  1


Polling Mode: MESSAGE BASED (ALLOW SLAVE TO INITIATE MESSAGES)

Master message transmit: BETWEEN STATION POLLS
Press a function key or enter a value.
>
Rem Prog  Forces:None                5/30 File BATCH30
Accept    Chan 0 Select
Edits     Status Option
F1        F9      F10
    
```

Configuring the processors for point-to-multipoint (half duplex)

continued from previous pages

use your SLC programming software
to configure SLC 5/03 channel 0



```
+ ----- Channel Configuration ----- +
CHANNEL 0 CONFIGURATION
  Current Communication Mode:  SYSTEM
  User Mode Driver:           DF1 HALF-DUPLEX SLAVE
  Write Protect:             DISABLED
  Mode Change:               RESERVED
  Mode Attention Character:   RESERVED
  System Mode Character:     RESERVED
  User Mode Character:       RESERVED
  Edit Resource/File Owner Timeout: 60 (seconds)

CHANNEL 1 CONFIGURATION
  System Mode Driver:        DH-485 MASTER
  Write Protect:            DISABLED
  Edit Resource/File Owner Timeout: 10 (seconds)

+ ----- CHANNEL 0 SYSTEM MODE CONFIGURATION ----- +
Communication Driver:      DF1 HALF-DUPLEX SLAVE
Diagnostic File:          RESERVED
Baud Rate:                9600
Duplicate Detect:         DISABLED
Poll Timeout [x20 ms]:   500
Control Line:             HALF-DUPLEX WITH CONTINUOUS CARRIER
Parity:                   NONE
Station Address:          99
Error Detect:              CRC
RTS Off Delay [x20 ms]:  0
RTS Send Delay [x20 ms]: 0
Message Retries:         3
EOT Suppression:         NO

Press a function key

REM PROG

ACCEPT      UNDO      CHANNEL      SELECT
EDITS      EDITS      STATUS      OPTION
F1         F2         F9         F10
```

The SLC 5/03 OS302 and the SLC 5/04 OS401 support the SLC processor as a DF1 half-duplex master. All earlier SLC 5/03 and SLC 5/04 processors only support the SLC processor as DF1 half-duplex slave.


Application requirements

Use half-duplex protocol for a network of multiple slaves and one master that are connected by radio-frequency or leased-line modems in typical SCADA applications.

The maximum cable length for an RS-232 serial link is 15 m (50 ft).

Communicating over a serial link

In a point-to-multipoint configuration, the messaging is between remote stations. The master station polls each slave for data and routes data to the slaves.

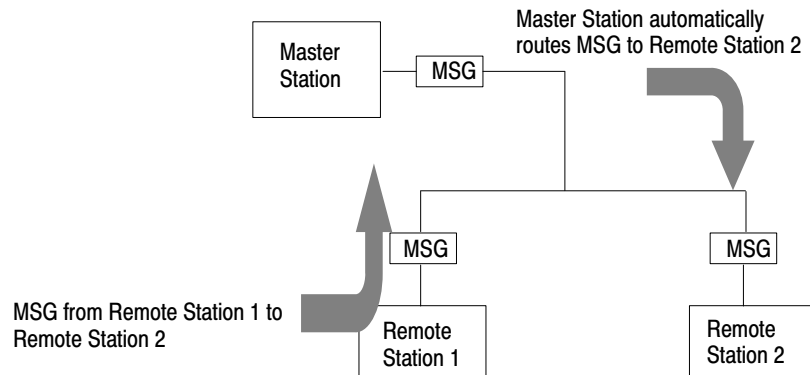

Using half-duplex protocol

Half-duplex DF1 protocol provides a multi-drop single master/multiple slave network. In contrast to full-duplex DF1 protocol, communication takes place in one direction at a time and is controlled by the master. You can use channel 0 as a programming port or as a peer-to-peer port using the MSG instruction.

In half-duplex mode as a slave, the SLC 5/03 processor can send data packets only when it is first polled by the master device, which initiates all communication with slaves. The master polls each remote station on the network on a regular and sequential basis. A master device usually supports routing of data packets from one remote station to another, or slave-to-slave communication.

If the master device has no data to send, it can still receive data from the slave. To do this, the master sends out a poll packet addressed to the slave. If the slave has data to send, it does so in response to the poll packet. Otherwise the slave sends a simple two-byte response, so that the master knows that it is active.

Half-duplex DF1 supports up to 254 slaves (address 0 to 254) with address 255 reserved for master broadcasts. The SLC 5/03 supports broadcast reception.

You can use either half-duplex or full-duplex modems for the master, but you must use half-duplex modems for the remote stations, assuming there is more than one on a point-to-multipoint network.

Selecting a communication mode

A PLC-5 master station can communicate with remote stations in one of two communication modes:

If the PLC-5 master station initiates:	Select this communication mode:	To achieve these results:
polling packets to remote stations according to their position on a polling list Polling packets are formed independently of any user-programming.	standard communication mode see the configuration information on page 7	This is the communication mode used most often in point-to-multipoint configurations. Provides for these capabilities: <ul style="list-style-type: none"> • remote stations can send messages to the master station (polled report-by-exception) • remote stations can send messages to each other • lets the master station maintain an active node table
communication to remote stations using only user-programmed message (MSG) instructions Each request for data from a remote station must be programmed via a message instruction.	message-based communication mode see the configuration information on page 7	If your application uses satellite transmission or public switched telephone network transmission, consider choosing message-based. Communication to a remote station can be initiated on an as-needed basis.

Creating station lists

If you select standard communication mode for the PLC-5 processor, you have to create station lists for the PLC-5 processor. You create a station list by entering the station address of each remote station into either a normal poll file or priority poll file by using the data monitor of your programming software. Place each station address in an individual word in a poll file (normal and priority) starting at word 2.

The normal poll file should contain the station addresses of the slaves on the link. The priority poll file contains the station addresses of any slaves that you need to collect data from more frequently. The master polls the stations in the priority file before polling the stations in the normal file.

The normal and priority poll file can each contain as many as 64 addresses (1 word per slave address). The poll file layout is as follows:

This word in a poll file:	Contains this information:
word 0	total number of stations to be polled (for a list) the address location (poll offset) of the station currently being polled
word 1	For example: a value of 1 means the station address stored in word 2 is being polled, 2 means the address stored in word 3 is being polled, etc. This word is automatically updated by the master station as a new remote station is polled.
word 2 through word xx	the remote station address in the order that the stations should be polled Store one station address in each word.

To place a station address in a poll file, do the following:

1. Access the data monitor in your programming software.
2. Specify the address of the integer file that is either the normal poll file or the priority poll file (i.e., if the normal poll file is N11, specify N11:0).
3. Enter the station addresses of the remote stations you want in the poll list starting at word 2. Put them in the order you want them to be polled.

Important: Station addresses are octal addresses. The poll files are integer files. To properly enter station addresses in a poll file, you must either:

- change the radix of the file to octal
- convert the octal station addresses to decimal

Figure 1 is an example of a station list containing three stations: octal addresses 10, 11, and 12. Station 12 (10 decimal) is being polled.

Figure 1
Example Station List (shown in decimal radix)

Poll File	Word 0	Word 1	Word 2	Word 3	Word 4
N:11	3	3	08	09	10
N:xx	total number of stations	pointer showing the station address being polled (Station 10 in word 4 being polled.)	address of first station in list	address of second station in list	address of third station in list

Monitoring active stations

To see what stations in a station list are active, use the data monitor to view the active station file. Each bit in the file represents a station on the link. The stations are numbered in order as a continuous bit-stream file starting with the first bit in the first word (Figure 2).

Figure 2
Example Active Station File

Address	15	Data	0
B11:0	1111 1111 1111 1111	←	Remote station 0
B11:1	1111 1111 1111 1111	←	Remote station 16 ₁₀
B11:2	1111 1111 1111 1111		


At power-up or after reconfiguration, the master station assumes that all remote stations are active. A station is shown inactive only after it fails to respond to a poll packet.

Additional documentation

- 1747-6.2 SLC 500 Modular Hardware Style Installation and Operation Manual
- 1785-6.1 PLC-5 Programming Software Instruction Set Reference Manual
- 1770-6.5.16 Data Highway/Data Highway Plus/DH-485 Protocol and Command Set Reference Manual
- AG-6.5.8 SCADA System Application Guide

Programming MSG instructions


PLC-5 MSG instructions

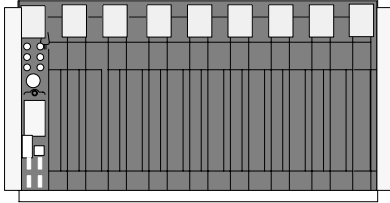

The MSG instruction transfers data in packets. Each DH+ data packet can contain as many as 120 words. If your message transfer contains more words than fit in one packet, the transfer requires more than one packet of transfer data. The more packets to transfer, the longer the transfer takes.

The PLC-5 processor can queue as many as 16 message instructions at one time – for all channels. The processor channels queue message instructions on a first-come-first-served basis.

SLC 5/03 MSG instructions



Data associated with a message write instruction is buffered when you enable the instruction. The SLC 5/03 with OS300 processor services as many as four message instructions at one time. The SLC 5/03 with OS301 services up to four message instructions per channel, for a maximum of eight message instructions. There is also a 10-deep message queue for each channel.

When the SLC 5/03 processor responds to a PLC-5 type message, the SLC processor doesn't allow any reading or writing of its input and output image table. If the SLC 5/03 processor initiates the message, it allows reading and writing of its input and output image table.

SLC 5/03 with OS300

If a MSG instruction is in one of the four "channel independent" transmission buffers and is waiting to be transmitted, its control block has status bits EN and EW set. If more than four MSG instructions are enabled at one time, a "channel-dependent" overflow queue stores the MSG instruction header blocks (not the data for a MSG write) from the fifth instruction to the fourteenth.

SLC 5/03 with OS301

If a MSG instruction is in one of the four "channel dependent" transmission buffers and is waiting to be transmitted, its control block has status bits EN and EW set. If more than four MSG instructions for that channel are enabled at one time, a "channel dependent" overflow queue stores the MSG instruction header blocks (not the data for a MSG write) from the fifth instruction to the fourteenth.

This instruction, queued in a FIFO order, has control block status bit EN set. If more than 14 MSG instructions are enabled at one time for any one channel, control block status bit WQ is set, as there may be no room available in the overflow queue. This instruction must be re-scanned until space exists in this queue.

You configure MSG command parameters based on the series of the SLC 5/03 processor. SLC 5/03 processors with OS301 and later support PLC-5 command parameters (see page 14); earlier SLC 5/03 processors must use the PLC-2[®] compatibility file (see page 21).

Using peer-to-peer commands

Keep these considerations in mind when configuring messages to communicate over a DH+ link between PLC-5 and SLC 5/03 processors with OS301 and later.

- The SLC processor can only address words 0 to 255 in a PLC-5 data table.
- In an SLC MSG instruction, the maximum number of words you can read from or write to a PLC-5 processor is 100 words.

SLC 5/03 MSG commands

Choose from the following MSG commands when sending MSG instructions from SLC 5/03 series C or later processors and PLC-5 processors. These commands simplify sending messages by eliminating the PLC-2 compatibility file for both the PLC-5 processor and the SLC 5/03 processor.

If you want the instruction to:	On this type of network:	Select these MSG command parameters:	
read data from a PLC-5 processor	local DH+	Type: Peer-to-Peer Read/Write: Read Target Device: PLC5 Local/Remote: Local	
	remote DH+	Type: Peer-to-Peer Read/Write: Read Target Device: PLC5 Local/Remote: Remote	
write data to a PLC-5 processor	local DH+	Type: Peer-to-Peer Read/Write: Write Target Device: PLC5 Local/Remote: Local	
	remote DH+	Type: Peer-to-Peer Read/Write: Write Target Device: PLC5 Local/Remote: Remote	

Use 14 words of bit or integer data for the control block. This is the control block layout if you select a PLC-5 as the target device:

Control block for an SLC MSG instruction to a PLC-5 processor

15	14	13	12	11	10	09	08	07	06	05	04	03	02	01	00	Word
EN ST DN ER CO EW NR TO								error code								0
node number																1
reserved for length in words																2
file number																3
file type (S, B, T, C, R, N, O, I, M0, M1)																4
element number																5
subelement number																6
reserved (internal messaging bits)													WQ		7	
message timer preset																8
reserved (internal use only)																9
message timer accumulator																10
reserved (internal use only)																11
reserved (internal use only)																12
reserved (internal use only)																13

PLC-5 MSG commands

Choose from the following MSG commands when sending MSG instructions from a PLC-5 processor to an SLC 5/03 processor. These MSG command types are only available with enhanced PLC-5 processors.

If you want the instruction to:	On this type of network:	Select these MSG command parameters:	
read data from an SLC processor without specifying the actual word length of the message	local DH+	Communication Command: Local/Remote: Local Node Address: Destination Data Table Address:	PLC-5 Typed Read From SLC Local address of SLC processor address to read in SLC data table
	remote DH+	Communication Command: Local/Remote: Local Node Address: Destination Data Table Address:	PLC-5 Typed Read From SLC Remote address of SLC processor address to read in SLC data table
write data to an SLC processor without specifying the actual word length of the message	local DH+	Communication Command: Local/Remote: Local Node Address: Destination Data Table Address:	PLC-5 Typed Write To SLC Local address of SLC processor address to write to in SLC data table
	remote DH+	Communication Command: Local/Remote: Local Node Address: Destination Data Table Address:	PLC-5 Typed Write To SLC Remote address of SLC processor address to write to in SLC data table
read a specific number of words of data from an SLC processor	local DH+	Communication Command: Local/Remote: Local Node Address: Destination Data Table Address:	SLC Typed Logical Read Local address of SLC processor address to read in SLC data table
	remote DH+	Communication Command: Local/Remote: Local Node Address: Destination Data Table Address:	SLC Typed Logical Read Remote address of SLC processor address to read in SLC data table
write a specific number of words of data to an SLC processor	local DH+	Communication Command: Local/Remote: Local Node Address: Destination Data Table Address:	SLC Typed Logical Write Local address of SLC processor address to write to in SLC data table
	remote DH+	Communication Command: Local/Remote: Local Node Address: Destination Data Table Address:	SLC Typed Logical Write Remote address of SLC processor address to write to in SLC data table

When deciding how to send data through MSG instructions, keep these requirements in mind:

- The maximum message size for PLC-5 processors is 100 words (200 bytes).
- The maximum message size for SLC 5/03 processors is 112 words (224 bytes).

Important: The PLC5 Typed Write to SLC and PLC5 Typed Read from SLC commands are accessible only with release 5.0 and later 6200 programming software.

Using the MG control block, the control block size is fixed at 56 words. You must use the MG control block if you send messages to an SLC processor using the SLC read and write commands, or if you are send a message out any port other than channel 1A. This is the control block layout for a PLC-5 MSG instruction:

Control block for a PLC-5 MSG instruction

15	14	13	12	11	10	09	08	07	06	05	04	03	02	01	00	Word
EN ST DN ER CO EW NR TO																0
error code (.ERR)																1
requested length (.RLEN)																2
done length (.DLEN)																3
modifiers (.DATA [0])																4
module class										push wheel						5
port ID										command type						6
command										function						7
station ID (6 words) .DATA [4] - .DATA [9]																8
local data table address (9 words) .DATA [10] - .DATA [18]																14
length remote address										parameters length						23
remote data table address (15 words) .DATA [20] - .DATA [34]																24
logical address of parameters file (9 words) .DATA [35] - .DATA [43]																39
reply class										reply pushwheel						48
reply mailbox										spare						49
port ID (6 words) .DATA [46] - .DATA [51]																50

ATTENTION: Use care when addressing PLC-5 MG.DATA structures. The information in these structures is vital to your control program. Changing MG.DATA values could severely affect the operation of your process.

Sending SLC Typed Logical Read and Typed Logical Write commands

Follow these guidelines when programming SLC Typed Logical Read and SLC Typed Logical Write commands:


- You must use the MG data type for the MSG control block.
- The PLC-5 data table address and the destination address types should match when the data type is supported by the PLC-5 and SLC processors. If you want to send a data type that the SLC processor does not support, the SLC processor interprets that data as integer. This table maps the data types from the PLC-5 processor to the SLC processor.

This PLC-5 data type:	Is interpreted by the SLC 5/03 processor as:	This PLC-5 data type:	Is interpreted by the SLC 5/03 processor as:
Binary (B)	bit	String (ST)	string
Integer (N)	integer	BT control (BT)	integer
Output (O)	integer	Timer (T)	timer
Input (I)	integer	Counter (C)	counter
Status (S)	integer	Control (R)	control
ASCII (A)	ASCII	Float (F)	float
BCD (D)	integer	MSG control (MG)	integer
SFC status (SC)	integer	PID control (PD)	integer

- To read/write from the SLC input, output (read only), or status file, specify an integer PLC-5 data table address and specify the address of the SLC input, output, or status file. For example, S:37 for word 37 of the SLC status file. Specify SLC input/output addresses by logical format, i.e., O:001 references slot 1.
- PLC-5 ASCII data is byte data (1/2 word) whereas, an SLC ASCII data element is one word. Therefore, if you request a PLC-5 Typed Read of 10 elements, the SLC 500 processor sends a packet containing 20 bytes (10 words).
- PLC-5 processors allow 1000 elements per file for most data types whereas SLC 500 processors allow 256 elements per file.

Figure 3
Sending a read MSG instruction from a PLC-5 processor to an SLC 5/03 processor

ladder rung

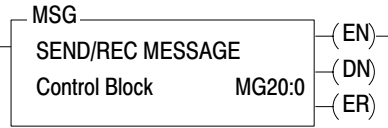

control block

```

MESSAGE INSTRUCTION DATA ENTRY FOR CONTROL BLOCK MG20:10

Communication Command      PLC-5 TYPED READ FROM SLC
PLC-5 Data Table Address:  N15:0
Size in Elements:          1
Local/Remote:              LOCAL
Remote Station:            N/A
Link ID:                   N/A
Remote Link Type:          N/A
Local Node Address:        15
Destination Data Table Address: N10:0
Port Number                1A

BLOCK SIZE IS 56

Press a key to change a parameter or <ENTER> to accept parameters.

Program  Forces:None    Edits:None          PLC-5/40  Addr 11  DRILL1
Read/   PLC-5  Size in Local/ Remote  Link  Remote  Local  Destin  Port
Write  Address Elemnts Remote  Station  ID      Link   Node   Address  Number
F1     F2     F3     F4     F5     F6     F7     F8     F9     F10
    
```


Annotations on the right side of the control block:

- Enter SLC 5/03 station address (octal) - points to the value 15 in the Local Node Address field.
- Address in SLC 5/03 processor - points to the value N10:0 in the Destination Data Table Address field.
- MSG being sent out channel 1A - points to the value 1A in the Port Number field.


This MSG example tells the PLC-5 processor (station 11₈) to read the information from N10:0 in an SLC 5/03 processor station 15₈ and place the information in N15:0 in the PLC-5 processor.

Figure 4
Sending a write MSG instruction from an SLC 5/03 processor to a PLC-5 processor

ladder rung

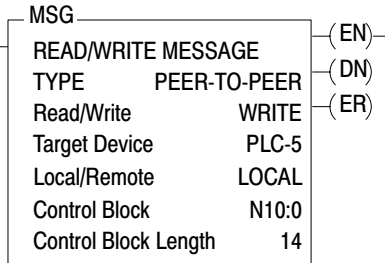

control block

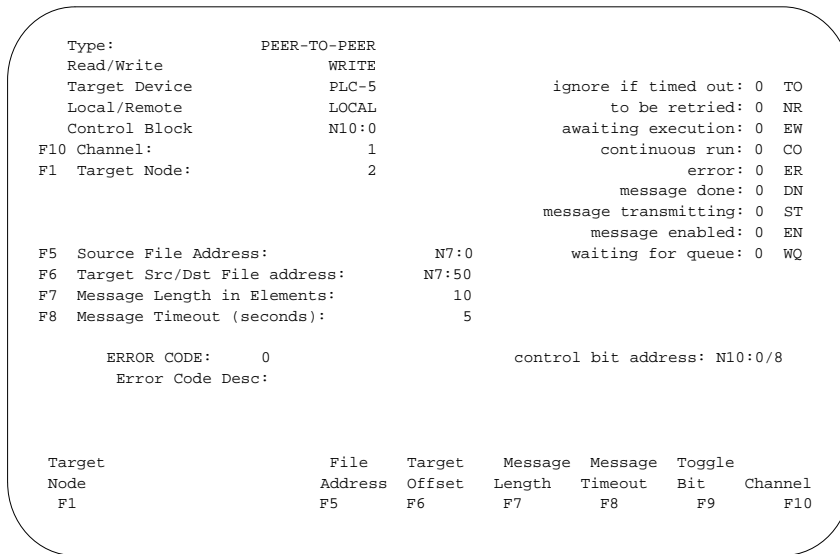

The SLC 5/03 processor writes 10 elements to Target Node 2's N7 file, starting at word N7:50. The words are from the SLC integer file starting at word N7:0. If 5 seconds elapse without a reply, error bit N10:0/12 is set and error code 37h is displayed, indicating that the instruction timed out.

Using a PLC-2 compatibility file

When you send messages from a PLC-5 processor to an SLC 5/03 with OS300, you must use the PLC-2 compatibility file.

Keep these considerations in mind when you use a PLC-2 compatibility files to transfer messages between PLC-5 and SLC 5/03 processors.

both point-to-point and point-to-multipoint configurations

- In the SLC 5/03 MSG instruction, the Target Node is the decimal DF1 station address of the PLC-5 processor and Target Offset is the decimal “byte offset,” which is the element into or from which you want to write or read data.
- The SLC processor uses word addressing while the PLC-5 processor uses byte addressing. In the Target Offset field of the SLC MSG control block, enter a word value that is equivalent to the byte (element) of the PLC-5 file number you want to write data into or read data from. One word equals two bytes; never enter an odd value for a Target Offset.
- The SLC processor can directly address only words 0_{10} to 127_{10} in a PLC-5 data table. By specifying a byte offset of 254 in the Target Offset field and a Message Length of 112, you can indirectly address words 128_{10} to 238_{10} (SLC 5/03 processor) in a PLC-5 data table.
- In a single instruction, the maximum amount of words you can read from or write to an SLC 5/03 processor is 112 words

point-to-point configurations

- In the PLC-5 processor, create integer files that correspond to the station addresses of the SLC processor that will be sending messages to the PLC-5 processor. When an SLC 5/03 processor sends a MSG instruction to a PLC-5 processor, the SLC 5/03 processor reads data from and writes data to a PLC-5 integer file that is equal to the SLC 5/03 processor’s DF1 station address. For example, if the SLC 5/03 processor has a DF1 station address of 10, data is read from or written to N10 in the PLC-5 data table.

point-to-multipoint configurations

- In the SLC 5/03 processor, create and make available file N9 for PLC-2 type read and write messages, because the destination file of a PLC-2 type message to an SLC 5/03 processor defaults to N9 in a point-to-point configuration.

In full-duplex mode, specify the destination and source addresses as:

This address:	Is the node address of the:
destination	node for which the packet is intended
source	sender

SLC processors use word addressing while PLC-5 processors use byte addressing. Two bytes in the PLC-5 processor are equivalent to one word in the SLC processor. You can select whether the SLC processor uses word or byte addressing.

When you use this addressing:	The PLC-5 MSG instruction's destination address must be between:
SLC word	010 ₈ and 177 ₈ This range corresponds to word 16 through word 254 (even words only). Set SLC status bit S:2/8=0; this is the default setting.
SLC byte	010 ₈ and 377 ₈ This range corresponds to word 8 through word 254. Set SLC status bit S:2/8=1.

If you use the PLC-2 compatibility file, set S:2/8 in the SLC status file to 1. This bit is the CIF (Common Interface File) Addressing Mode selection bit and lets the SLC processor accept "byte offsets" from a PLC-5 processor. You must also create the CIF file, which is always integer file 9 in an SLC 5/03 or SLC 5/04 processor.

You cannot access words 0 - 7 or directly access 100₈ - 107₈ (64₁₀-71₁₀) in an SLC 5/02 Common Interface File from a PLC-5 processor.

**SLC 5/03 command parameters
using a PLC-2 compatibility file**

Choose from the following MSG command parameters when sending MSG instructions from SLC 5/03 processors that are earlier than series C and PLC-5 processors.

If you want the instruction to:	On this type of network:	Select these MSG command parameters:	
read data from a PLC-5 processor	local DH+	Type: Read/Write: Target Device: Local/Remote:	Peer-to-Peer Read 485CIF Local
	remote DH+	Type: Read/Write: Target Device: Local/Remote:	Peer-to-Peer Read 485CIF Remote
write data to a PLC-5 processor	local DH+	Type: Read/Write: Target Device: Local/Remote:	Peer-to-Peer Write 485CIF Local
	remote DH+	Type: Read/Write: Target Device: Local/Remote:	Peer-to-Peer Write 485CIF Remote

Use 14 words of bit or integer data for the control block. This is the control block layout if you select a PLC-5 as the target device:

**Control block for an SLC 5/03 MSG instruction
using a PLC-2 compatibility file (485CIF)**

15	14	13	12	11	10	09	08	07	06	05	04	03	02	01	00	Word
EN ST DN ER CO EW NR TO												error code				0
node number																1
reserved for length in words																2
offset in words																3
source address field																4
not used																5
not used																6
reserved (internal messaging bits)													WQ		7	
message timer preset																8
reserved (internal use only)																9
message timer accumulator																10
reserved (internal use only)																11
reserved (internal use only)																12
reserved (internal use only)																13

**PLC-5 command parameters
using a PLC-2 compatibility file**

Choose from the following MSG command parameters when sending MSG instructions from PLC-5 processors to SLC 5/03 processors earlier than series C.

If you want the instruction to:	On this type of network:	Select these MSG command parameters:	
read 16-bit words from any area of the PLC-2 data table or PLC-2 compatibility file.	local DH+	Communication Command:	PLC-2 Unprotected Read
		Local/Remote:	Local
		Local Node Address:	address of SLC processor (octal)
		Destination Data Table Address:	file offset in CIF SLC file (N9)
	remote DH+	Communication Command:	PLC-2 Unprotected Read
		Local/Remote:	Remote
		Local Node Address:	address of SLC processor (octal)
		Destination Data Table Address:	file offset in CIF SLC file (N9)
write 16-bit words to any area of the PLC-2 data table or PLC-2 compatibility file.	local DH+	Communication Command:	PLC-2 Unprotected Write
		Local/Remote:	Local
		Local Node Address:	address of SLC processor (octal)
		Destination Data Table Address:	file offset in CIF SLC file (N9)
	remote DH+	Communication Command:	PLC-2 Unprotected Write
		Local/Remote:	Remote
		Local Node Address:	address of SLC processor (octal)
		Destination Data Table Address:	file offset in CIF SLC file (N9)

The MG control block is fixed at 56 words. You must use the MG control block if you send messages to an SLC processor using the SLC read and write commands, or if you are send a message out any port other than channel 1A. This is the control block layout for a PLC-5 MSG instruction:


Control block for a PLC-5 MSG instruction

15	14	13	12	11	10	09	08	07	06	05	04	03	02	01	00	Word
EN ST DN ER CO EW NR TO																0
error code (.ERR)																1
requested length (.RLEN)																2
done length (.DLEN)																3
modifiers (.DATA [0])																4
module class										push wheel						5
port ID										command type						6
command										function						7
station ID (6 words) .DATA [4] - .DATA [9]																8
local data table address (9 words) .DATA [10] - .DATA [18]																14
length remote address										parameters length						23
remote data table address (15 words) .DATA [20] - .DATA [34]																24
logical address of parameters file (9 words) .DATA [35] - .DATA [43]																39
reply class										reply pushwheel						48
reply mailbox										spare						49
port ID (6 words) .DATA [46] - .DATA [51]																50

ATTENTION: Use care when addressing PLC-5 MG.DATA structures. The information in these structures is vital to your control program. Changing MG.DATA values could severely affect the operation of your process.

Figure 5
Sending a read MSG instruction from a PLC-5 processor to an SLC 5/03 processor

ladder rung

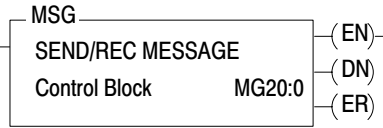

control block

```

MESSAGE INSTRUCTION DATA ENTRY FOR CONTROL BLOCK MG20:10

Communication Command      PLC-2 UNPROTECTED READ
PLC-5 Data Table Address:  N15:0
Size in Elements:          1
Local/Remote:              LOCAL
Remote Station:            N/A
Link ID:                   N/A
Remote Link Type:         N/A
Local Node Address:        15
Destination Data Table Address: 77
Port Number                0

BLOCK SIZE IS 56

Press a key to change a parameter or <ENTER> to accept parameters.

Program  Forces:None      Edits:None          PLC-5/40 Addr 11 DRILL1
Read/   PLC-5 Size in Local/ Remote Link Remote Local Destin Port
Write  Address Elemnts Remote Station ID Link Node Address Number
F1     F2     F3     F4     F5     F6     F7     F8     F9     F10
    
```


Annotations on the right side of the control block:

- ← MSG being sent to a PLC-2-like device (points to "PLC-2 UNPROTECTED READ")
- ← Enter octal equivalent of the SLC 5/03 decimal station address (points to "N15:0")
- ← File offset (in octal) of SLC 5/03 file N9 (points to "77")
- ← MSG being sent out channel 0 (points to "0")

This MSG example tells the PLC-5 processor (station 11₈) to read the information from SLC 5/03 remote station 13₁₀'s (15₈) common interface file N9, offset 77₈ (63₁₀) and place the information in station 11₈'s file N15:0.

Set S:2/8 in the SLC 5/03 status file to 1. This bit is the CIF (Common Interface File) Addressing Mode selection bit and lets the SLC 5/03 processor accept "byte-offsets" from a PLC-5 processor.

Figure 6
Sending a write MSG instruction from an SLC 5/03
processor to a PLC-5 processor

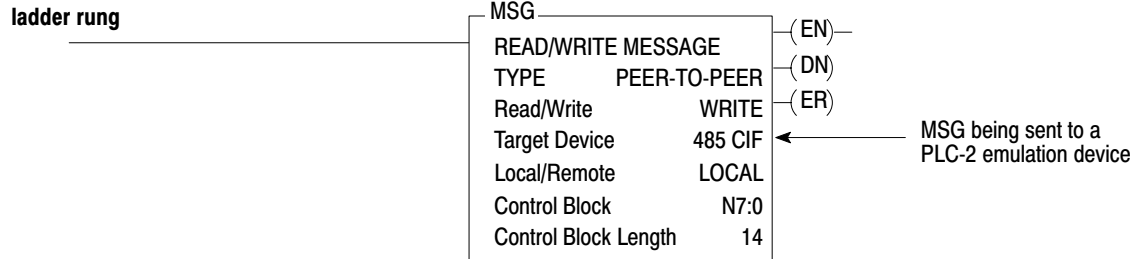

control block

```

Type:                PEER-TO-PEER
Read/Write           WRITE
Target Device        485 CIF
Local/Remote         LOCAL
Control Block        N7:0
F10 Channel:         0
F1 Target Node:      9
                    ignore if timed out: 0 TO
                    to be retried: 0 NR
                    awaiting execution: 0 EW
                    continuous run: 0 CO
                    error: 0 ER
                    message done: 0 DN
                    message transmitting: 0 ST
                    message enabled: 0 EN
                    waiting for queue: 0 WQ

F5 Source File Address: S:37
F6 Target Offset:      20
F7 Message Length in Elements: 6
F8 Message Timeout (seconds): 60

ERROR CODE: 0000
Error Code Desc:

control bit address: N7:0/8

Target      File      Target      Message      Message      Toggle
Node        Address  Offset      Length      Timeout      Bit      Channel
F1          F5       F6          F7          F8          F9      F10
    
```

This MSG example is telling the SLC 5/03 remote station (station 99₁₀) to write the information from its S:37-S:42 through its serial port (channel 0) to the PLC-5 master station 9₁₀. The data's destination is N99:10 of the PLC-5 processor, based on a byte target offset of 20₁₀.

Important: The SLC 5/03 processor writes the information into an integer file in the PLC-5 processor's data table. The integer file number is equivalent to the SLC 5/03 processor's station address (which is PLC-2 emulation).

For example, if the SLC 5/03 processor in this example is station 99₁₀, then it writes the data from its S:37-S:42 into N99 of the PLC-5 master station. File N99 must exist in the PLC-5 for it to receive data from the SLC 5/03 remote station.

DH+, PLC, PLC-2, PLC-5, SLC, SLC 5/03, and SLC 5/04 are trademarks of Allen-Bradley Company, Inc.



Allen-Bradley, a Rockwell Automation Business, has been helping its customers improve productivity and quality for more than 90 years. We design, manufacture and support a broad range of automation products worldwide. They include logic processors, power and motion control devices, operator interfaces, sensors and a variety of software. Rockwell is one of the worlds leading technology companies.



Worldwide representation.

Argentina • Australia • Austria • Bahrain • Belgium • Brazil • Bulgaria • Canada • Chile • China, PRC • Colombia • Costa Rica • Croatia • Cyprus • Czech Republic • Denmark • Ecuador • Egypt • El Salvador • Finland • France • Germany • Greece • Guatemala • Honduras • Hong Kong • Hungary • Iceland • India • Indonesia • Ireland • Israel • Italy • Jamaica • Japan • Jordan • Korea • Kuwait • Lebanon • Malaysia • Mexico • Netherlands • New Zealand • Norway • Pakistan • Peru • Philippines • Poland • Portugal • Puerto Rico • Qatar • Romania • Russia-CIS • Saudi Arabia • Singapore • Slovakia • Slovenia • South Africa, Republic • Spain • Sweden • Switzerland • Taiwan • Thailand • Turkey • United Arab Emirates • United Kingdom • United States • Uruguay • Venezuela • Yugoslavia

Allen-Bradley Headquarters, 1201 South Second Street, Milwaukee, WI 53204 USA, Tel: (1) 414 382-2000 Fax: (1) 414 382-4444