

# Installation Instructions

Original Instructions



**Allen-Bradley**  
by ROCKWELL AUTOMATION



## 59RF RFID 40x40 mm Square Transceiver

Catalog Number 59RF-TR-4040

### Features

- IO-Link V1.1 communication
- Read/write speeds up to 26.6 kbit/s
- ICODE ISO 15693 compliant
- Built-in indicators for diagnostics
- Reliable performance in harsh environments
- Universal mounting




### Typical Applications

- Asset tracking
- Data acquisition
- Product handling
- Tool management
- Automotive
- Food and pharmaceutical
- Security and entrance

### Minimum Distance Between Transceivers


Read/write modules must not mutually influence each other. For this reason, a minimum distance (b) between the devices must be observed.

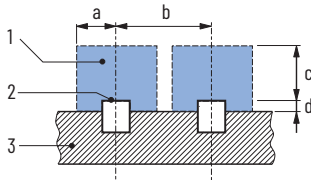

Item	Description
1	Unique transponder zone
2	Sensing face
3	Support

Item	Description [mm (in.)]
a	60 (2.36)
b	120 (4.72)
c	120 (4.72)
d	10 (0.39)

### Transceiver/Transponder Recommended Distances

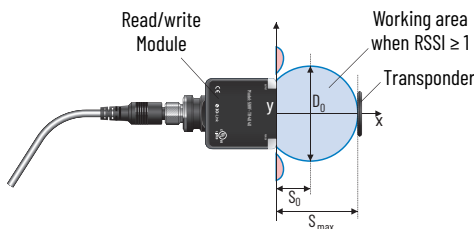


Transponder Type	S <sub>max</sub> [mm (in.)]	S <sub>0</sub> [mm (in.)]	D <sub>0</sub> [mm (in.)]
Ø50 mm (1.97 in.) diameter	78 (3.07)	41 (1.61)	80 (3.15)

### Specifications

Attribute	59RF-TR-4040
Supply voltage	11...32V DC
Current consumption, max	50 mA
Tag compatibility	ISO 15693
Connector	M12 4-pin male
Communication systems	IO-Link V1.1
Communication rate (host)	230,400 bps
Frequency	13.56 MHz
Process data width IN	32 bytes
Process data width OUT	32 bytes
Operating temperature	-25...+80 °C (-13...+176 °F)
Storage temperature	-25...+80 °C (-13...+176 °F)
Enclosure rating	IP68/IP69K
Material (face/body)	PBT/chrome-plated brass
Recommended sensing distance <sup>(1)</sup>	41 mm (1.61 in.)
Sensing distance, max <sup>(1)</sup>	78 mm (3.07 in.)
Distance from IO-Link master, max	20 m (65.6 ft)
Compliance	CE, FCC, IC, cULus

(1) Range reference for 50 mm (1.97 in.) diameter tag.

### Indicator Illumination Pattern

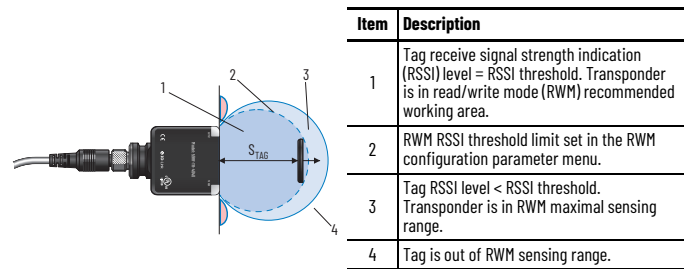


Q1/Tag Error

Q1/Busy Power

	Q1/Tag		Q2/Busy		Error	Power
	IO-Link	SIO	IO-Link	SIO		
ON	Area 2	Q1 is ON	—	Q1 is ON	Error occurred	RWM is ON and standalone mode (SIO) is used
OFF	Area 4	Q1 is OFF	No pending CMD	Q2 is OFF	No error	RWM is OFF
Blinking (1 Hz)	—	—	RWM busy	—	—	RWM is ON and IO-Link mode is used
Blinking (5 Hz)	Area 3	Q1 is tag present or compares Data and Area 3	—	Q1 is tag present or compares Data and Area 3	—	—

## Connector Pinout

Pin	Signal
1	24V DC
2	Data (SIO Q2)
3	GND
4	Data (SIO Q1) 

**IMPORTANT** Installation should be in accordance with local and/or national codes. Servicing energized industrial control equipment can be hazardous if not in accordance to recommended safety procedures.

## FCC Notice (For U.S. Customers)

This device complies with Part 15 of the FCC Rules. Operation is subject to the following conditions: (1) This device may not cause harmful interference; and (2) this device must accept any interference received, including interference that may cause undesired operation of the device.

Changes and modifications not expressly approved by Rockwell Automation can void your authority to operate this equipment under Federal Communications Commissions rules.


## IC Information

This device complies with Industry Canada license-exempt RSS standard(s). Operation is subject to the following two conditions: (1) this device may not cause interference; and (2) this device must accept any interference, including interference that may cause undesired operation of the device.

Le présent appareil est conforme aux CNR d'Industrie Canada applicables aux appareils radio exempts de licence. L'exploitation est autorisée aux deux conditions suivantes: (1) l'appareil ne doit pas produire de brouillage, et (2) l'utilisateur de l'appareil doit accepter tout brouillage radioélectrique subi, même si le brouillage est susceptible d'en compromettre le fonctionnement.

## Approximate Dimensions

Dimensions are shown in mm (in.) and are not intended to be used for installation purposes.

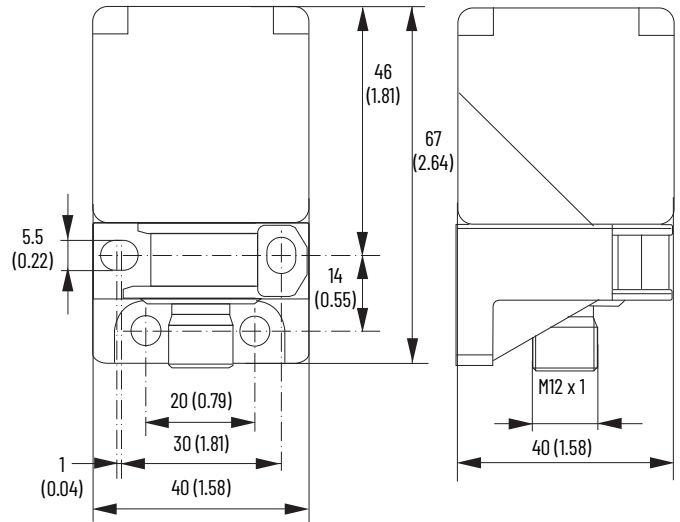

## Waste Electrical and Electronic Equipment (WEEE)







At the end of life, this equipment should be collected separately from any unsorted municipal waste.

Rockwell Automation maintains current product environmental compliance information on its website at [rok.auto/pec](http://rok.auto/pec).

Your comments help us serve your documentation needs better. If you have any suggestions on how to improve our content, complete the form at [rok.auto/docfeedback](http://rok.auto/docfeedback).

For technical support, visit [rok.auto/support](http://rok.auto/support).

Rockwell Otomasyon Ticaret A.Ş. Kar Plaza İş Merkezi E Blok Kat:6 34752, İçerenköy, İstanbul, Tel: +90 (216) 5698400 EEE Yönetmeliğine Uygundur

Connect with us.    

[rockwellautomation.com](http://rockwellautomation.com) expanding human possibility®

AMERICAS: Rockwell Automation, 1201 South Second Street, Milwaukee, WI 53204-2496 USA, Tel: (1) 414.382.2000, Fax: (1) 414.382.4444

EUROPE/MIDDLE EAST/AFRICA: Rockwell Automation NV, Pegasus Park, De Kleetlaan 12a, 1831 Diegem, Belgium, Tel: (32) 2 663 0600, Fax: (32) 2 663 0640

ASIA PACIFIC: Rockwell Automation, Level 14, Core F, Cyberport 3, 100 Cyberport Road, Hong Kong, Tel: (852) 2887 4788, Fax: (852) 2508 1846

Allen-Bradley, expanding human possibility, and Rockwell Automation are trademarks of Rockwell Automation, Inc. Trademarks not belonging to Rockwell Automation are property of their respective companies.

Publication 59RF-IN003A-EN-P - September 2021

Copyright © 2021 Rockwell Automation, Inc. All rights reserved. Printed in the U.S.A.

10005506853 Ver 00